
M/Y Example
FM200 CONTINUED

Superyacht Safety Systems

REVIEW SAMPLE - SOURCE ANNOTATIONS UNVERIFIED - NOT FOR OPERATIONAL USE

The image below shows the shut down valves for engines and generators as well as the manual release of FM 200 for the PMS (area).

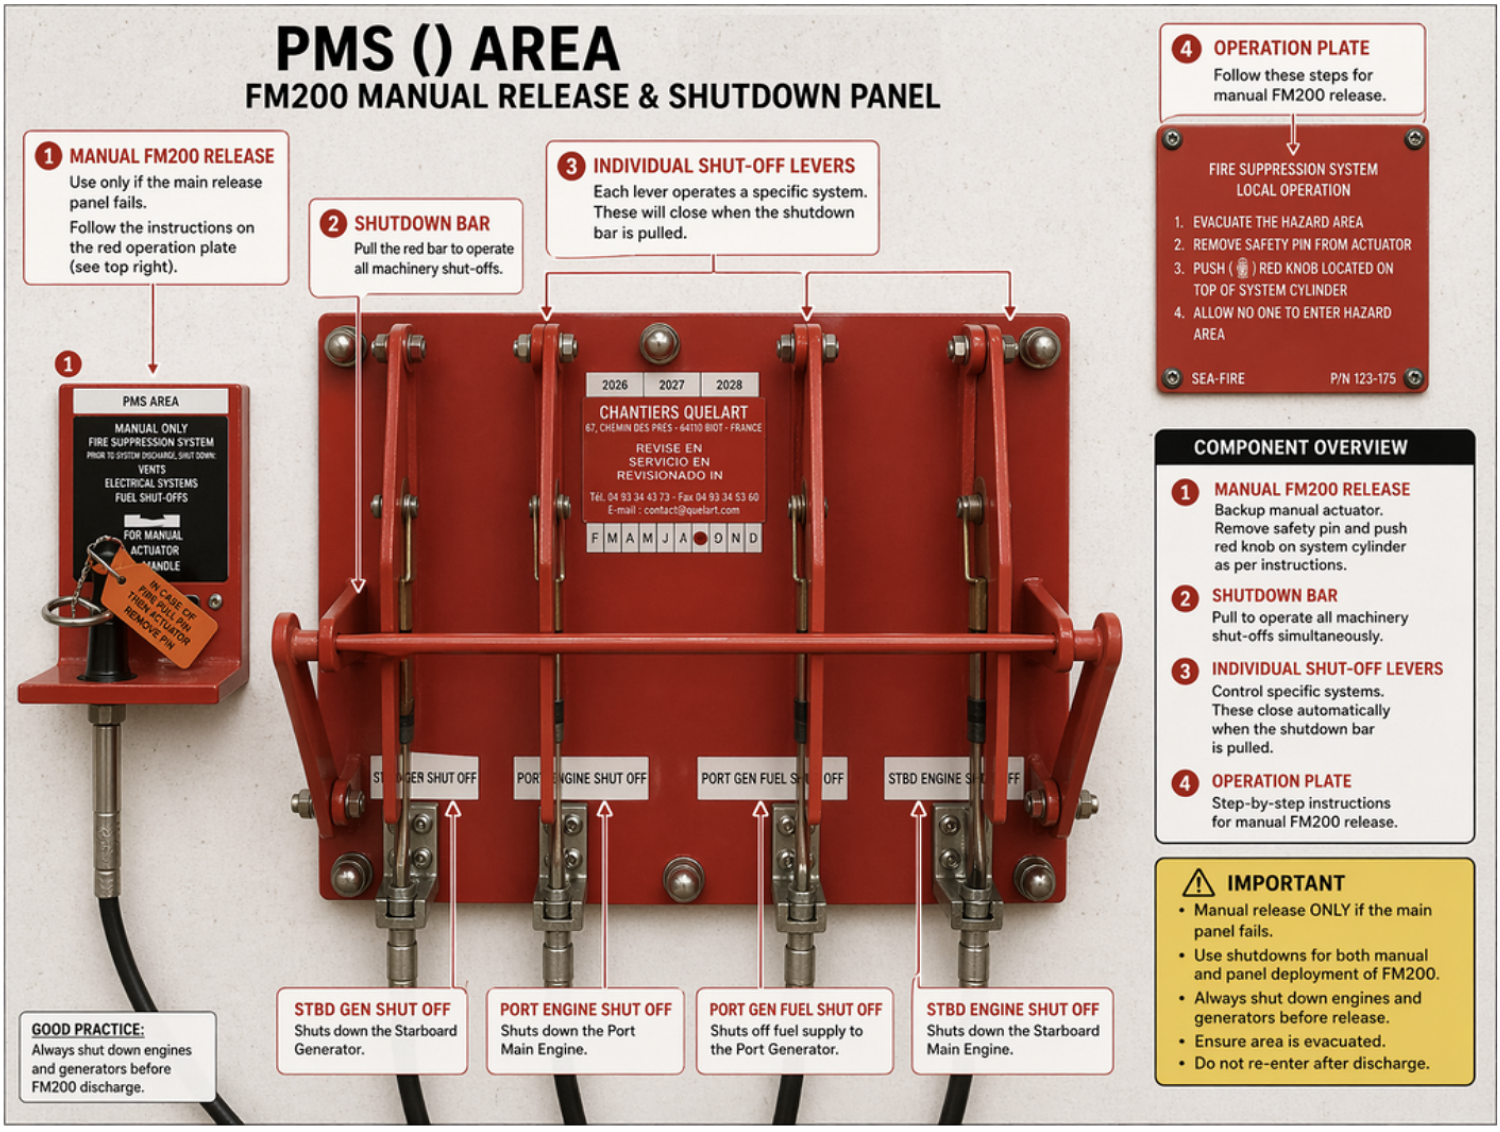

FM200 FAMILIARISATION - IDENTIFY, DO NOT ACTUATE

Point out the release control, shutdown bar and four labelled shutdowns. Explain the distinction between shutdown and extinguishing-agent release. Do not pull handles, remove pins or operate the bar during this identification exercise.

Verification pending: the source callouts describe both a remote handle and a cylinder actuator. The release route, shutdown links and “main panel fails” restriction have not been verified for this installation.